

ADDENDUM #3

September 25, 2017

**UNC Charlotte Sycamore Hall Renovation
Charlotte, North Carolina
SCO #16-12735**

This addendum is pursuant to the University of North Carolina General Administration Instructions to Bidders and General Conditions of the Contract in connection with the revision of Bidding Documents which have been previously issues.

Addenda are issued prior to execution of Contract. All instructions contained herein shall be reflected in the Contract Sum and this Addendum will be made a part of the Contract Documents, if, as and when a Construction Contract is awarded.

This Addendum forms a part of the Contract Documents and modifies the original documents dated August 25, 2017, as noted below. Acknowledge receipt of this Addendum in the space provided on the Form of Proposal. Failure to do so will subject the Bidder to disqualification.

REVISIONS TO DRAWINGS

1. Replace Sheet PH101 – Phasing Plan with attached.
2. BDE-1 – Partial Telephone Riser Diagram
3. BDE-2 – Sheet E002 Electrical Site Plan Notes

ATTACHMENTS

1. SHEET PH101 – PHASING PLAN
2. BDE-1 – PARTIAL TELEPHONE RISER DIAGRAM
3. BDE-2 – SHEET E002 ELECTRICAL SITE PLAN NOTES

END OF ADDENDUM #3



BID SET

ISSUE DATE: AUGUST 25, 2017


SCO ID# 16-12735-02A
CODE:41526 ITEM:303

SYCAMORE HALL RENOVATION
UNIVERSITY OF NORTH CAROLINA AT CHARLOTTE
9201 UNIVERSITY CITY BOULEVARD, CHARLOTTE, NC 28223


PROJECT NUMBER 1610
SHEET TITLE
CONSTRUCTION PHASING PLAN - SITE
SHEET NUMBER

PH101


CONSTRUCTION PHASING PLAN - SITE




PHASE "S-1"
1. START: NOTICE TO PROCEED
2. COMPLETE: PRIOR TO PHASE "S-4"
3. INCLUDES BUT NOT LIMITED TO:
• NEW TELECOM DUCTBANK WITH (1) 4" DIRECT-BURY CONDUIT FROM MANHOLE 58-A TO MANHOLE 58.




PHASE "S-2"
1. START: NOTICE TO PROCEED
2. COMPLETE: PRIOR TO PHASE "S-3"
3. INCLUDES BUT NOT LIMITED TO:
• PROVIDE NEW TAP ON EXISTING 3-PHASE SERVICE LINE TO CEDAR HALL BUILDING.
• NEW TAP SHALL RUN IN EXISTING SPARE CONDUIT BETWEEN SWITCH 64 AND MANHOLE 65.
• SEE SHEET E002 AND E003.




PHASE "S-3"
1. START: FOLLOWING COMPLETION OF PHASE "S-2"
2. COMPLETE: PRIOR TO PERMANENT POWER FOR SYCAMORE
3. INCLUDES BUT NOT LIMITED TO:
• NEW ELECTRICAL DUCTBANK FROM MANHOLE 65 TO NEW TRANSFORMER.
• NEW MANHOLE AS INDICATED ON SHEET E002 AND E003.



PHASE "S-4"
1. START: FOLLOWING COMPLETION OF PHASE "S-1"
2. COMPLETE: PROJECT COMPLETION DATE
3. INCLUDES BUT NOT LIMITED TO:
• PROVIDE NEW QUARTZITE BOX TO INTERCEPT EXISTING DIRECT-BURIED TELECOM CABLES AS INDICATED ON E002.
• PROVIDE (2) 4" CONDUITS FROM NEW QUARTZITE BOX TO TELECOM ROOM 201.

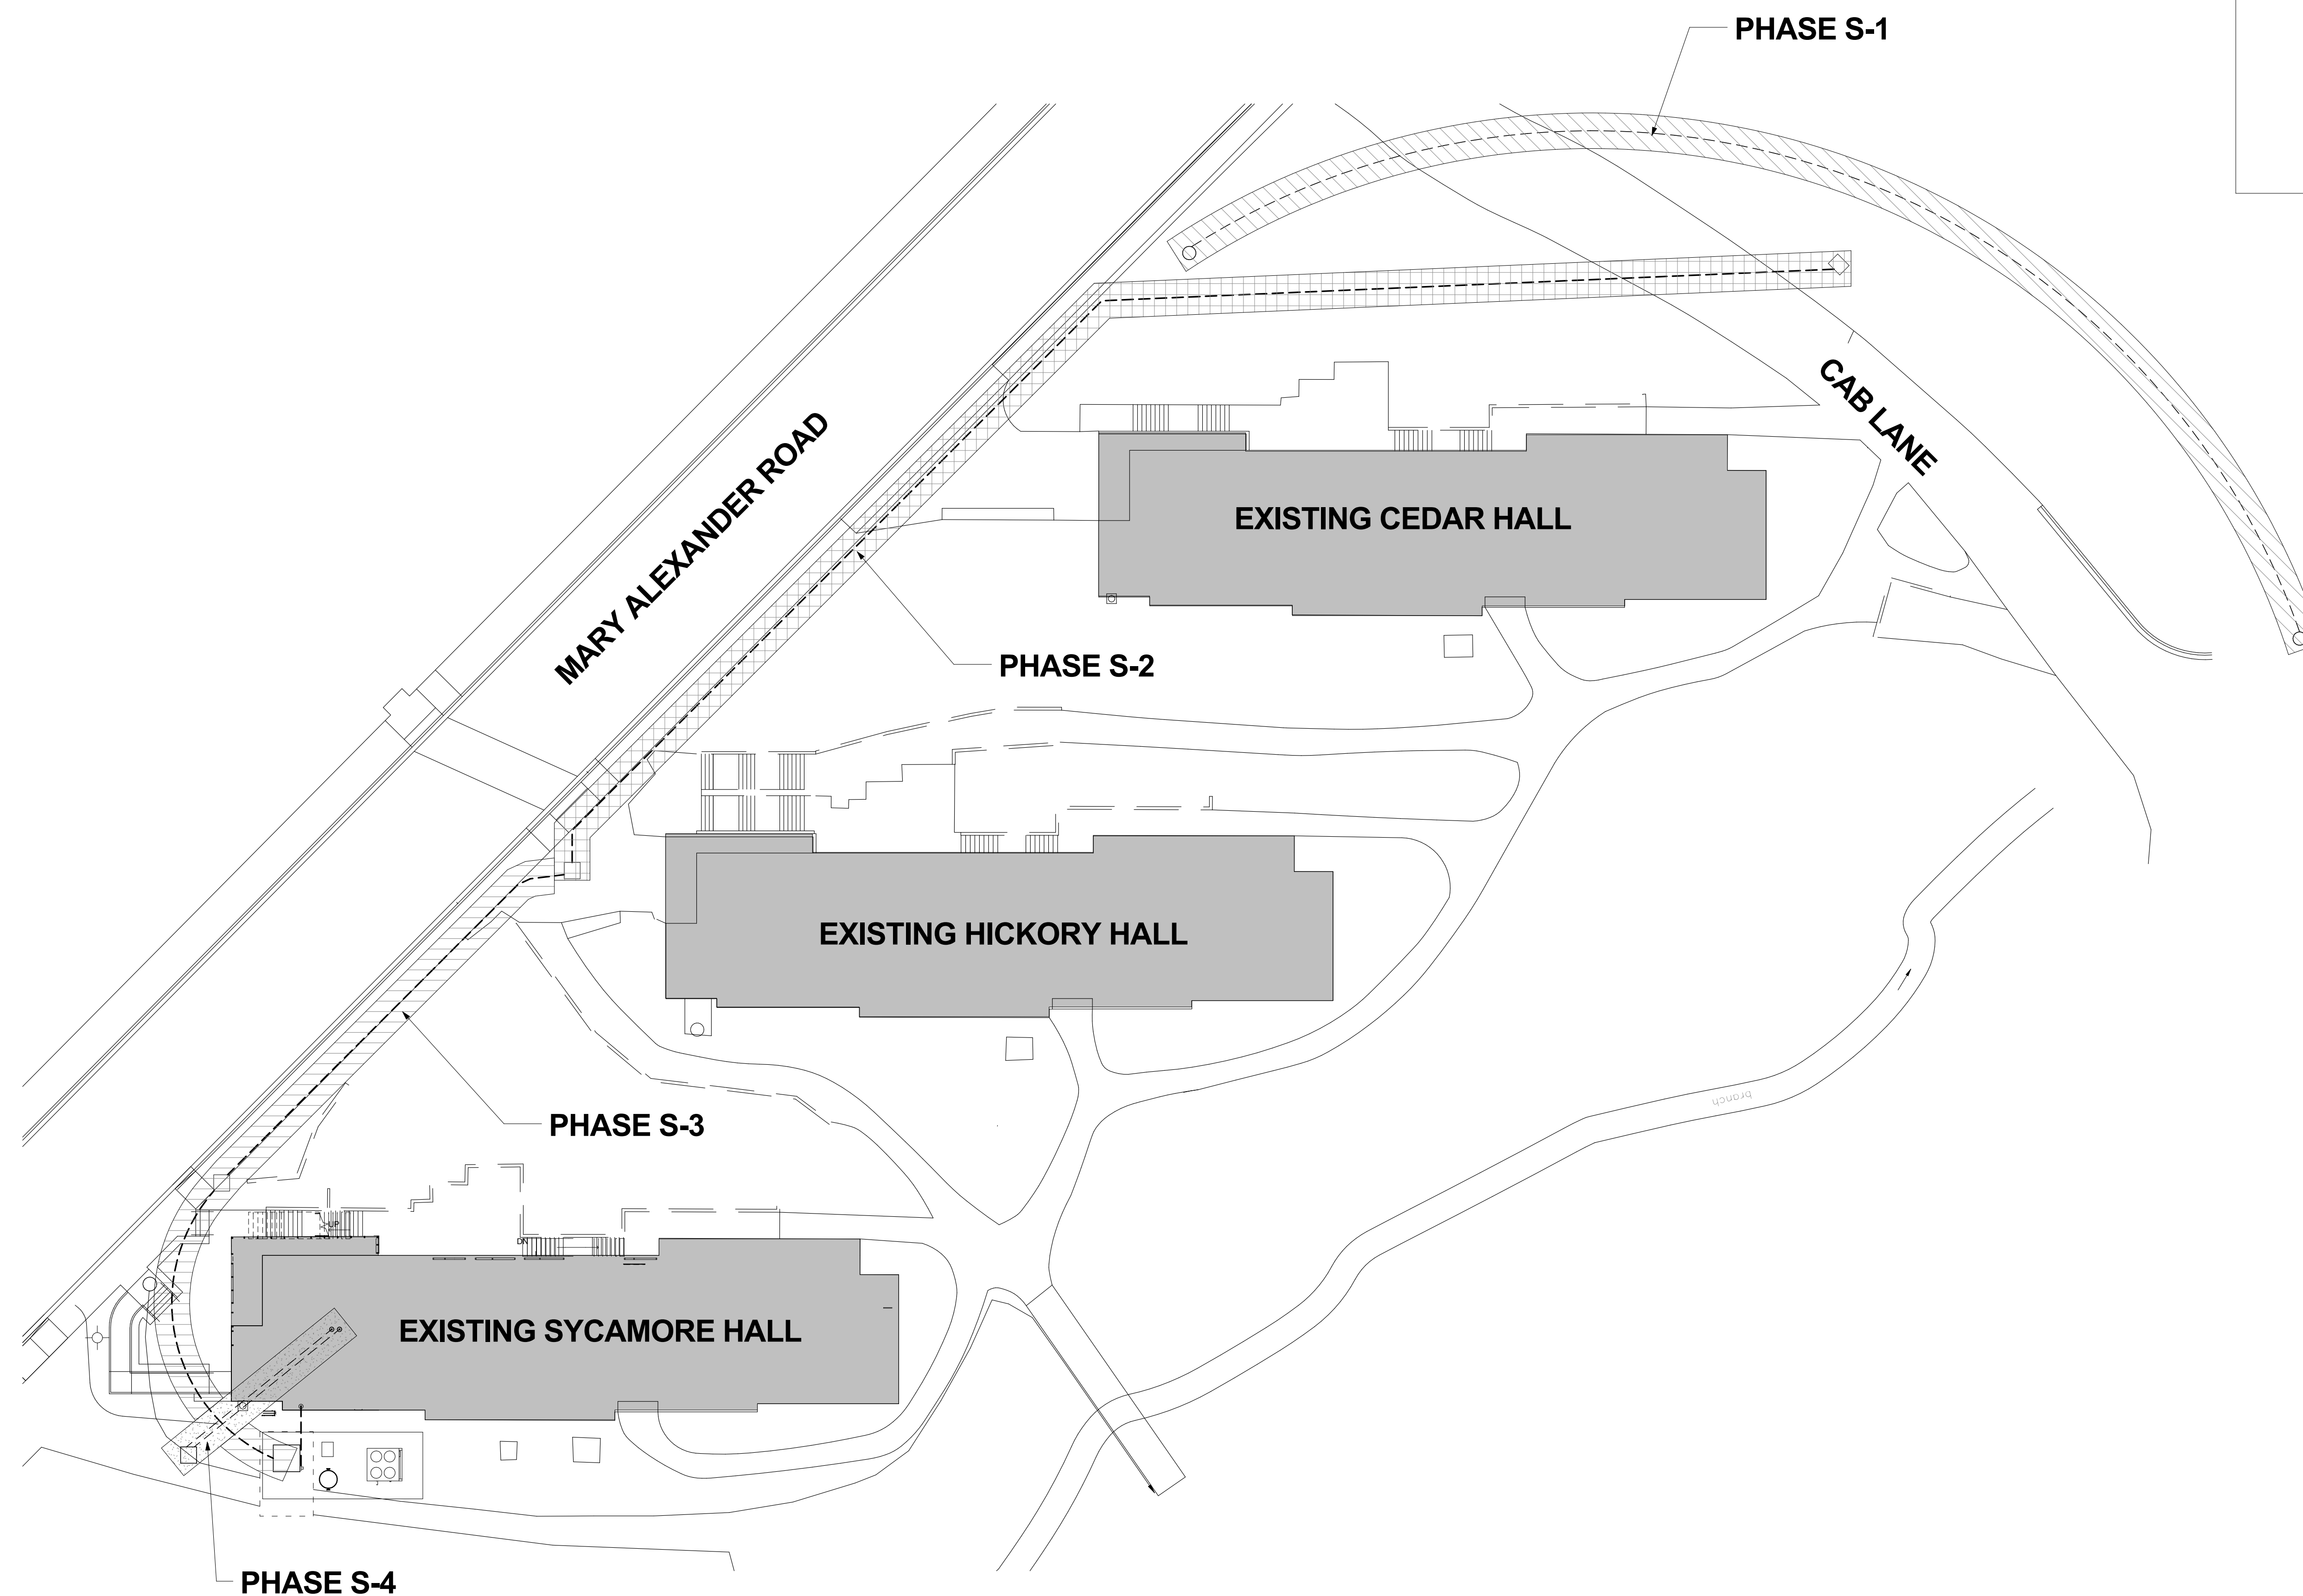

1 CONSTRUCTION PHASING PLAN - SITE
1" = 20'-0"

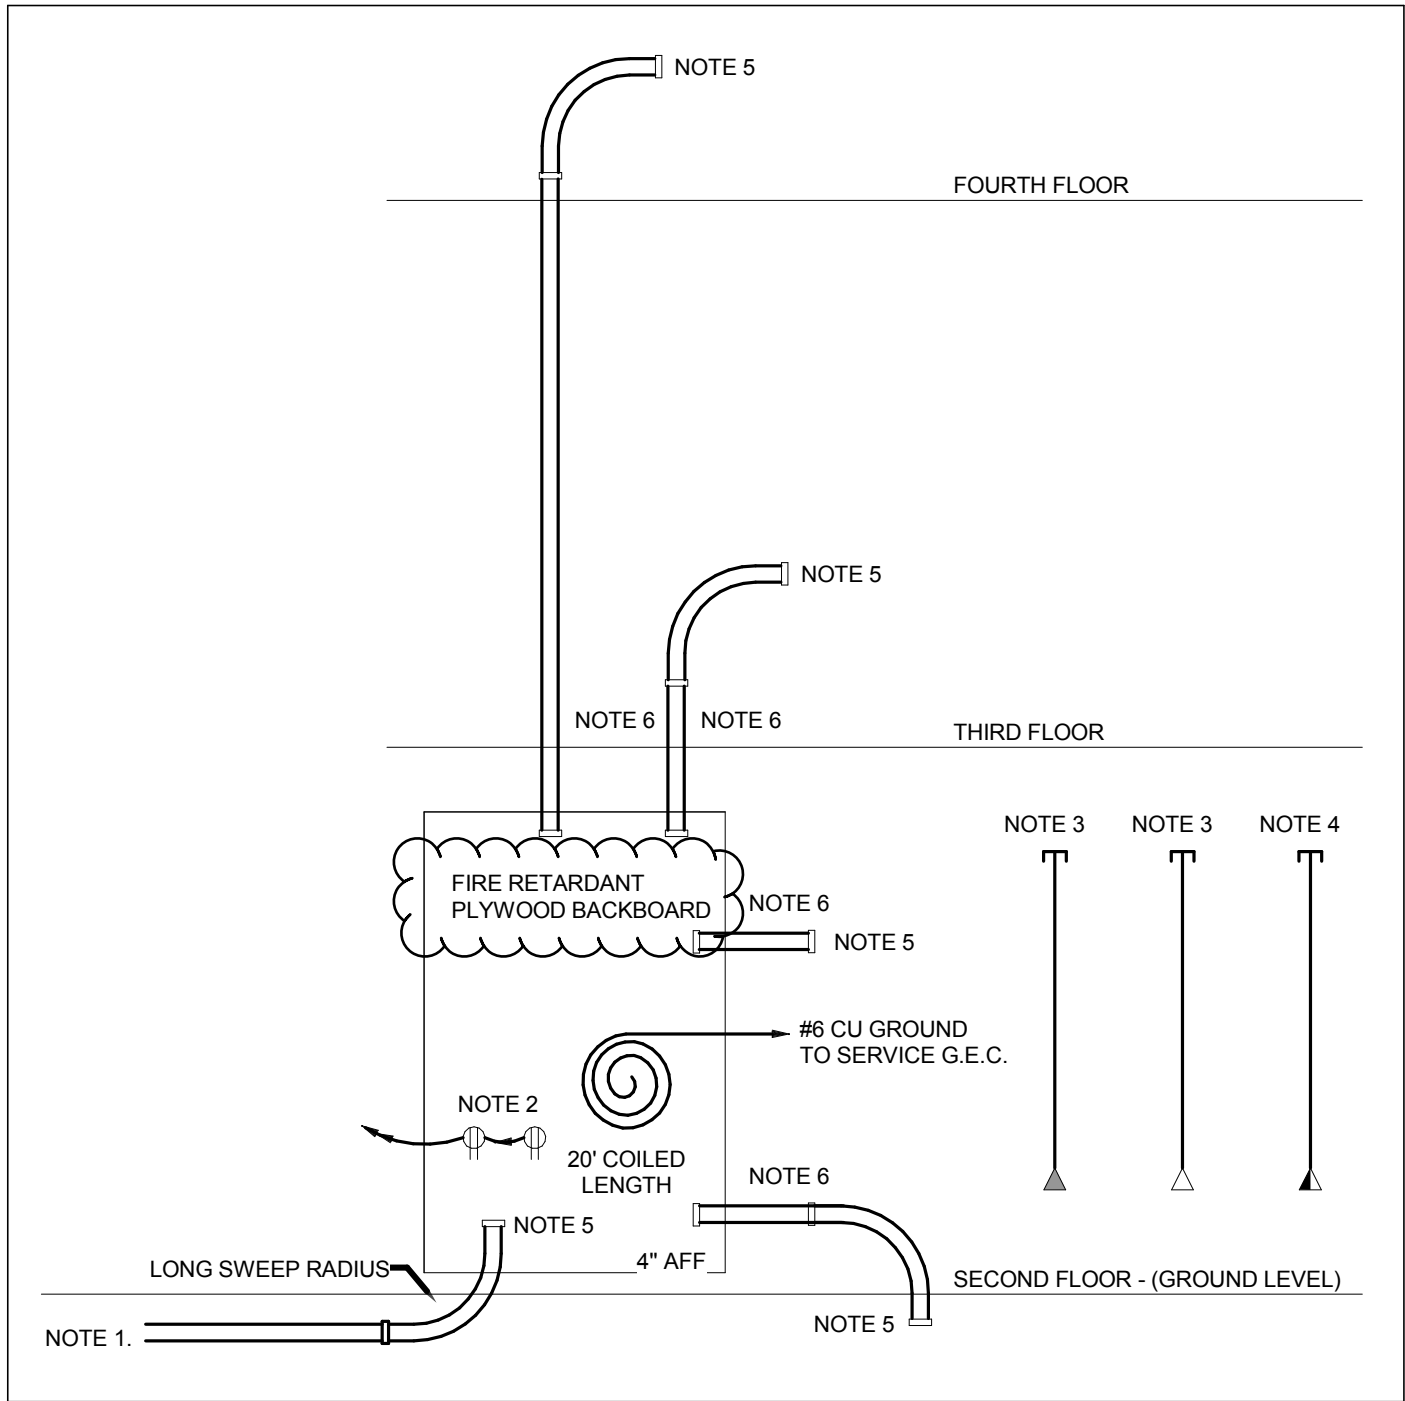

PURPOSE OF DRAWING: TO REVISE TELECOM BACKBOARD SPECIFICATION TO REMOVE INSTRUCTION TO PAINT BACKBOARD.

Morris·Berg
ARCHITECTS
6101 CARRIAGE BOULEVARD, SUITE 101 CHARLOTTE, NC 28209-4841
(704) 552-5900 FAX (704) 552-7420

SYCAMORE HALL
RENOVATION
9201 UNIVERSITY CITY
BOULEVARD, CHARLOTTE, NC
28223

BULLETIN DRAWING TITLE	PROJECT NUMBER
PARTIAL	1610
TELEPHONE RISER	DRAWING NUMBER
DIAGRAM	BDE-1
	DATE: 09/25/17

KEYED NOTES

1. SEE MECHANICAL CONNECTION SCHEDULE ON SHEET E005.
2. PROVIDE (2) 4" CONDUITS FROM NEW UNDERGROUND TELECOM BOX (NOTE 14) TO TELECOM ROOM 201.
3. NEW 500KVA TRANSFORMER FOR CONNECTION TO CAMPUS DISTRIBUTION SYSTEM. SEE ELECTRICAL RISER DIAGRAM SHEET E003.
4. SERVICE CONNECTION TO MAIN ELECTRICAL ROOM. SEE SHEET E003 FOR ELECTRICAL RISER AND DUCT BANK DETAILS.
5. PROVIDE CONNECTION FOR HEAT TRACE. COORDINATE LOCATION WITH EQUIPMENT INSTALLED. ENSURE HEAT TRACE IS PROVIDED WITH EQUIPMENT GROUND FAULT PROTECTION. MAKE ALL FINAL CONNECTIONS PER MANUFACTURER'S RECOMMENDATION.
6. PROVISIONS FOR CODE BLUE PHONE BY OTHERS. COORDINATE LOCATION AND CONNECTION WITH CAMPUS POLICE AND LOW VOLTAGE CONSULTANT.
7. EXISTING 1-PHASE SERVICE TO BE REMOVED. SEE SHEET E003.
8. EXISTING 3-PHASE SERVICE TO BE REMOVED. SEE SHEET E003.
9. NEW DUCT-BANK FROM MANHOLE-65 TO NEW TRANSFORMER. SEE SHEET E003 FOR ELECTRICAL RISER AND DUCT BANK DETAILS.
10. NEW ELECTRICAL MAN-HOLE. SEE SHEET E008, DETAIL #2, FOR ELECTRICAL RISER. SEE SHEET E003.
11. EXISTING TELECOM MAN-HOLE 58-A
12. PROVIDE (1) - 4" DIRECT BURRIED CONDUIT FROM MAN-HOLE 58-A TO MAN-HOLE 58. BURRIED PER UNCC STANDARDS.
13. EXISTING TELECOM MAN-HOLE 58.
14. NEW UNDERGROUND TELECOM BOX, SEE SHEET E008, DETAIL #1 EXISTING DIRECT-BURRIED TELECOM CABLES TO BE INTERCEPTED BY OTHERS.

PURPOSE OF DRAWING: REVISE NOTE #12 ON SHEET E002 TO REMOVE (2) 4" CONDUIT TELECOM DUCTBANK AND REPLACE WITH SINGLE 4" DIRECT-BURY CONDUIT.